


ANSI A137.1 Report

Regan Scientific Instruments

10/05/2016, 7:02PM


Method: DCOF
Facility: 018
Location: 002
Result: 0.50
Distance: 08 in.
Temp/Hum: 72 F, 55%

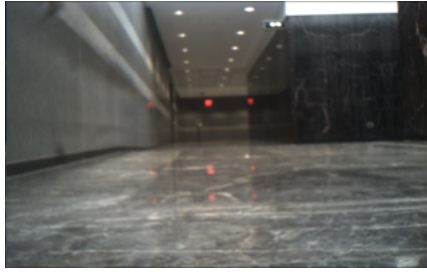

1.



2.

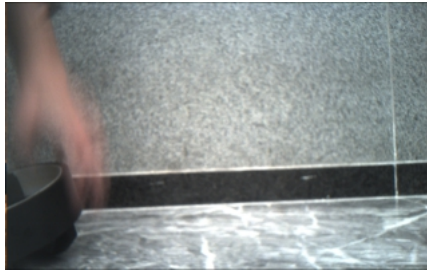


3.




4.


1. Avg = 0.49, Min = 0.41, Max = 0.56

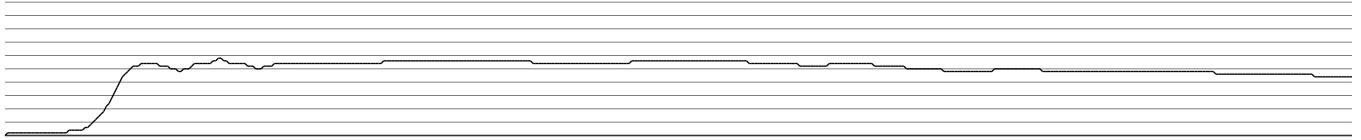


2. Avg = 0.62, Min = 0.49, Max = 0.81

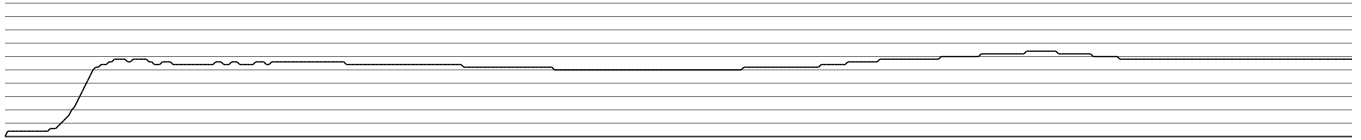

3. Avg = 0.49, Min = 0.31, Max = 0.72

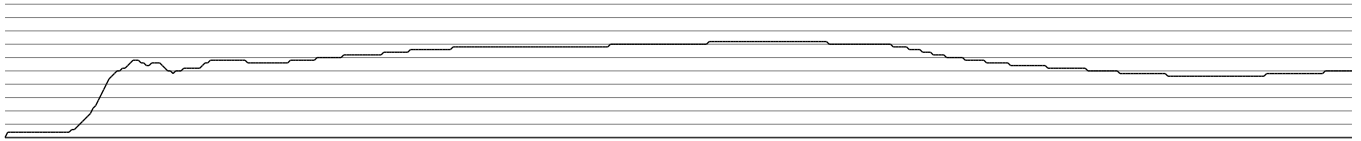

4. Avg = 0.41, Min = 0.34, Max = 0.57

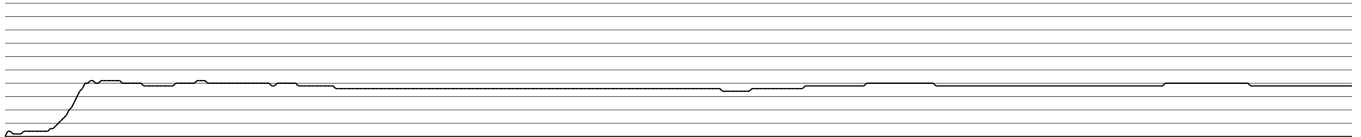

Device: BOT-3000E (v2.01.08)
Serial No: 00304
Calibration: 06/27/2016
Verification: 08/11/2016, 6:24PM PASS
Meter: 5.4 hrs

Sensor: 03201
Type: Rubber
Manuf. date: 07/18/2015
Ref. offset: ----